



INSTRUCTIONS

KEEP FOR REFERENCE.
Read manual 309107 for important
warnings and instructions.



*First choice when
quality counts.™*

309138

Rev. A

PRECISIONMix® II 3K System

Electrical Schematic




GRACO INC. P.O. BOX 1441 MINNEAPOLIS, MN 55440-1441


©COPYRIGHT 2000, GRACO INC.

Graco Inc. is registered to I.S. EN ISO 9001

Electrical Schematic 1

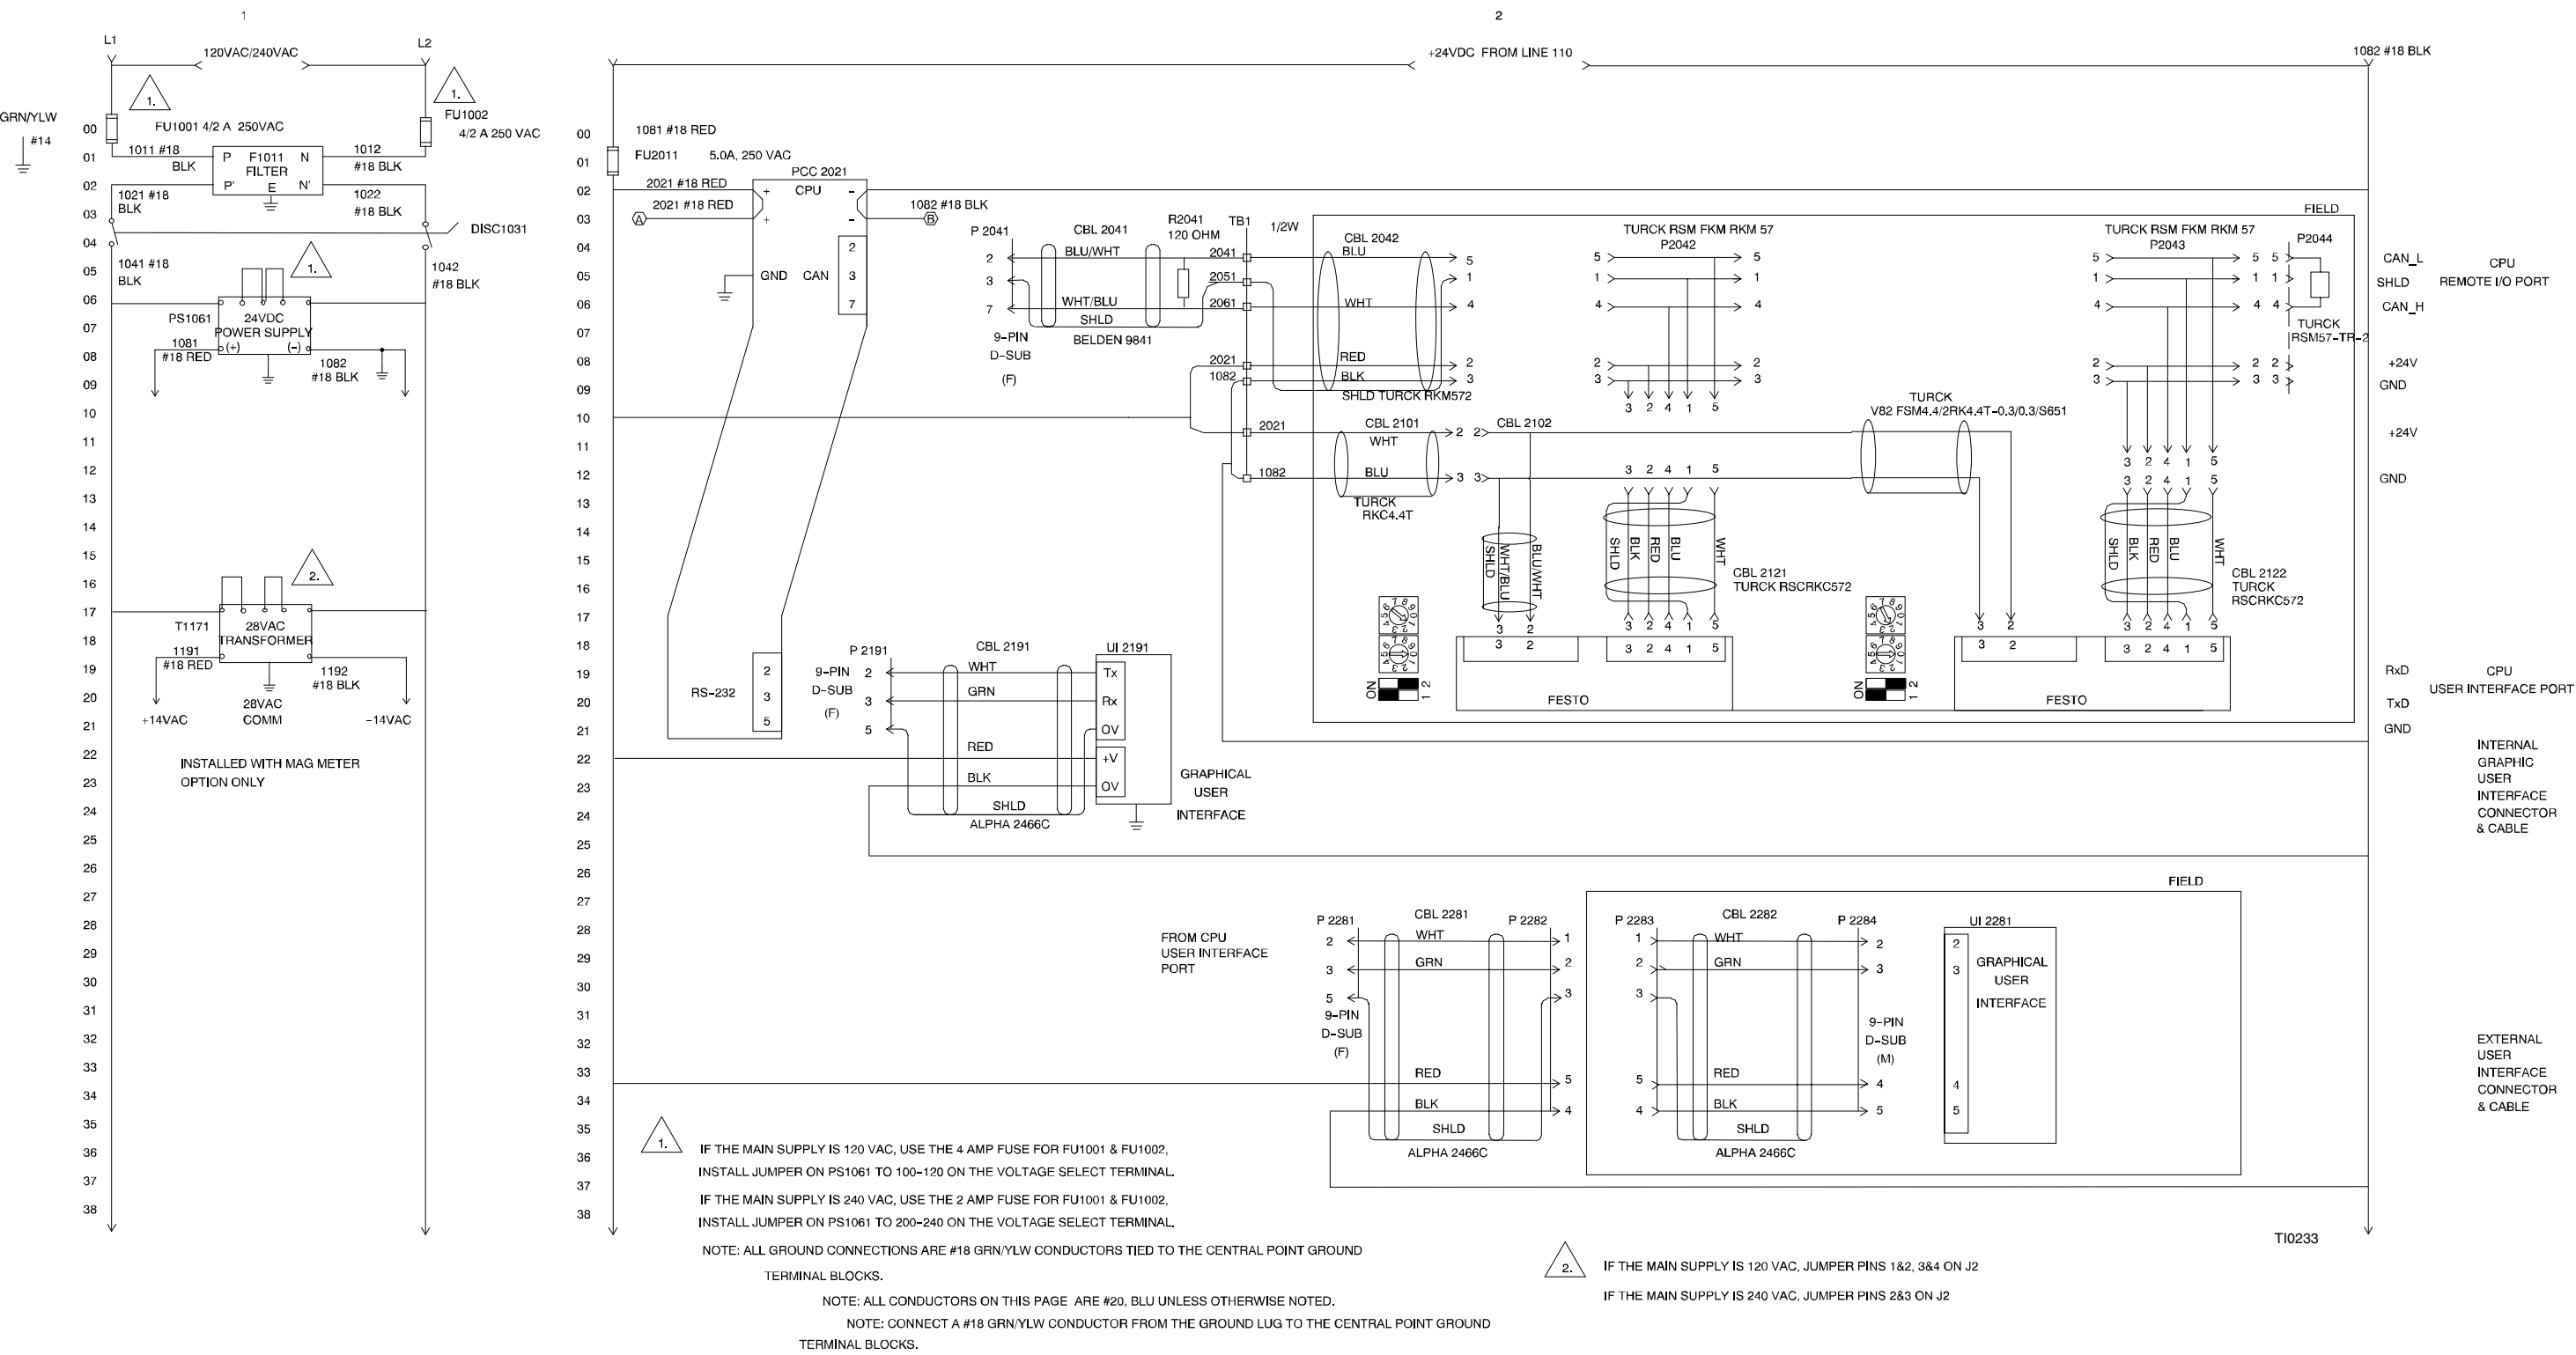

Electrical Schematic 2


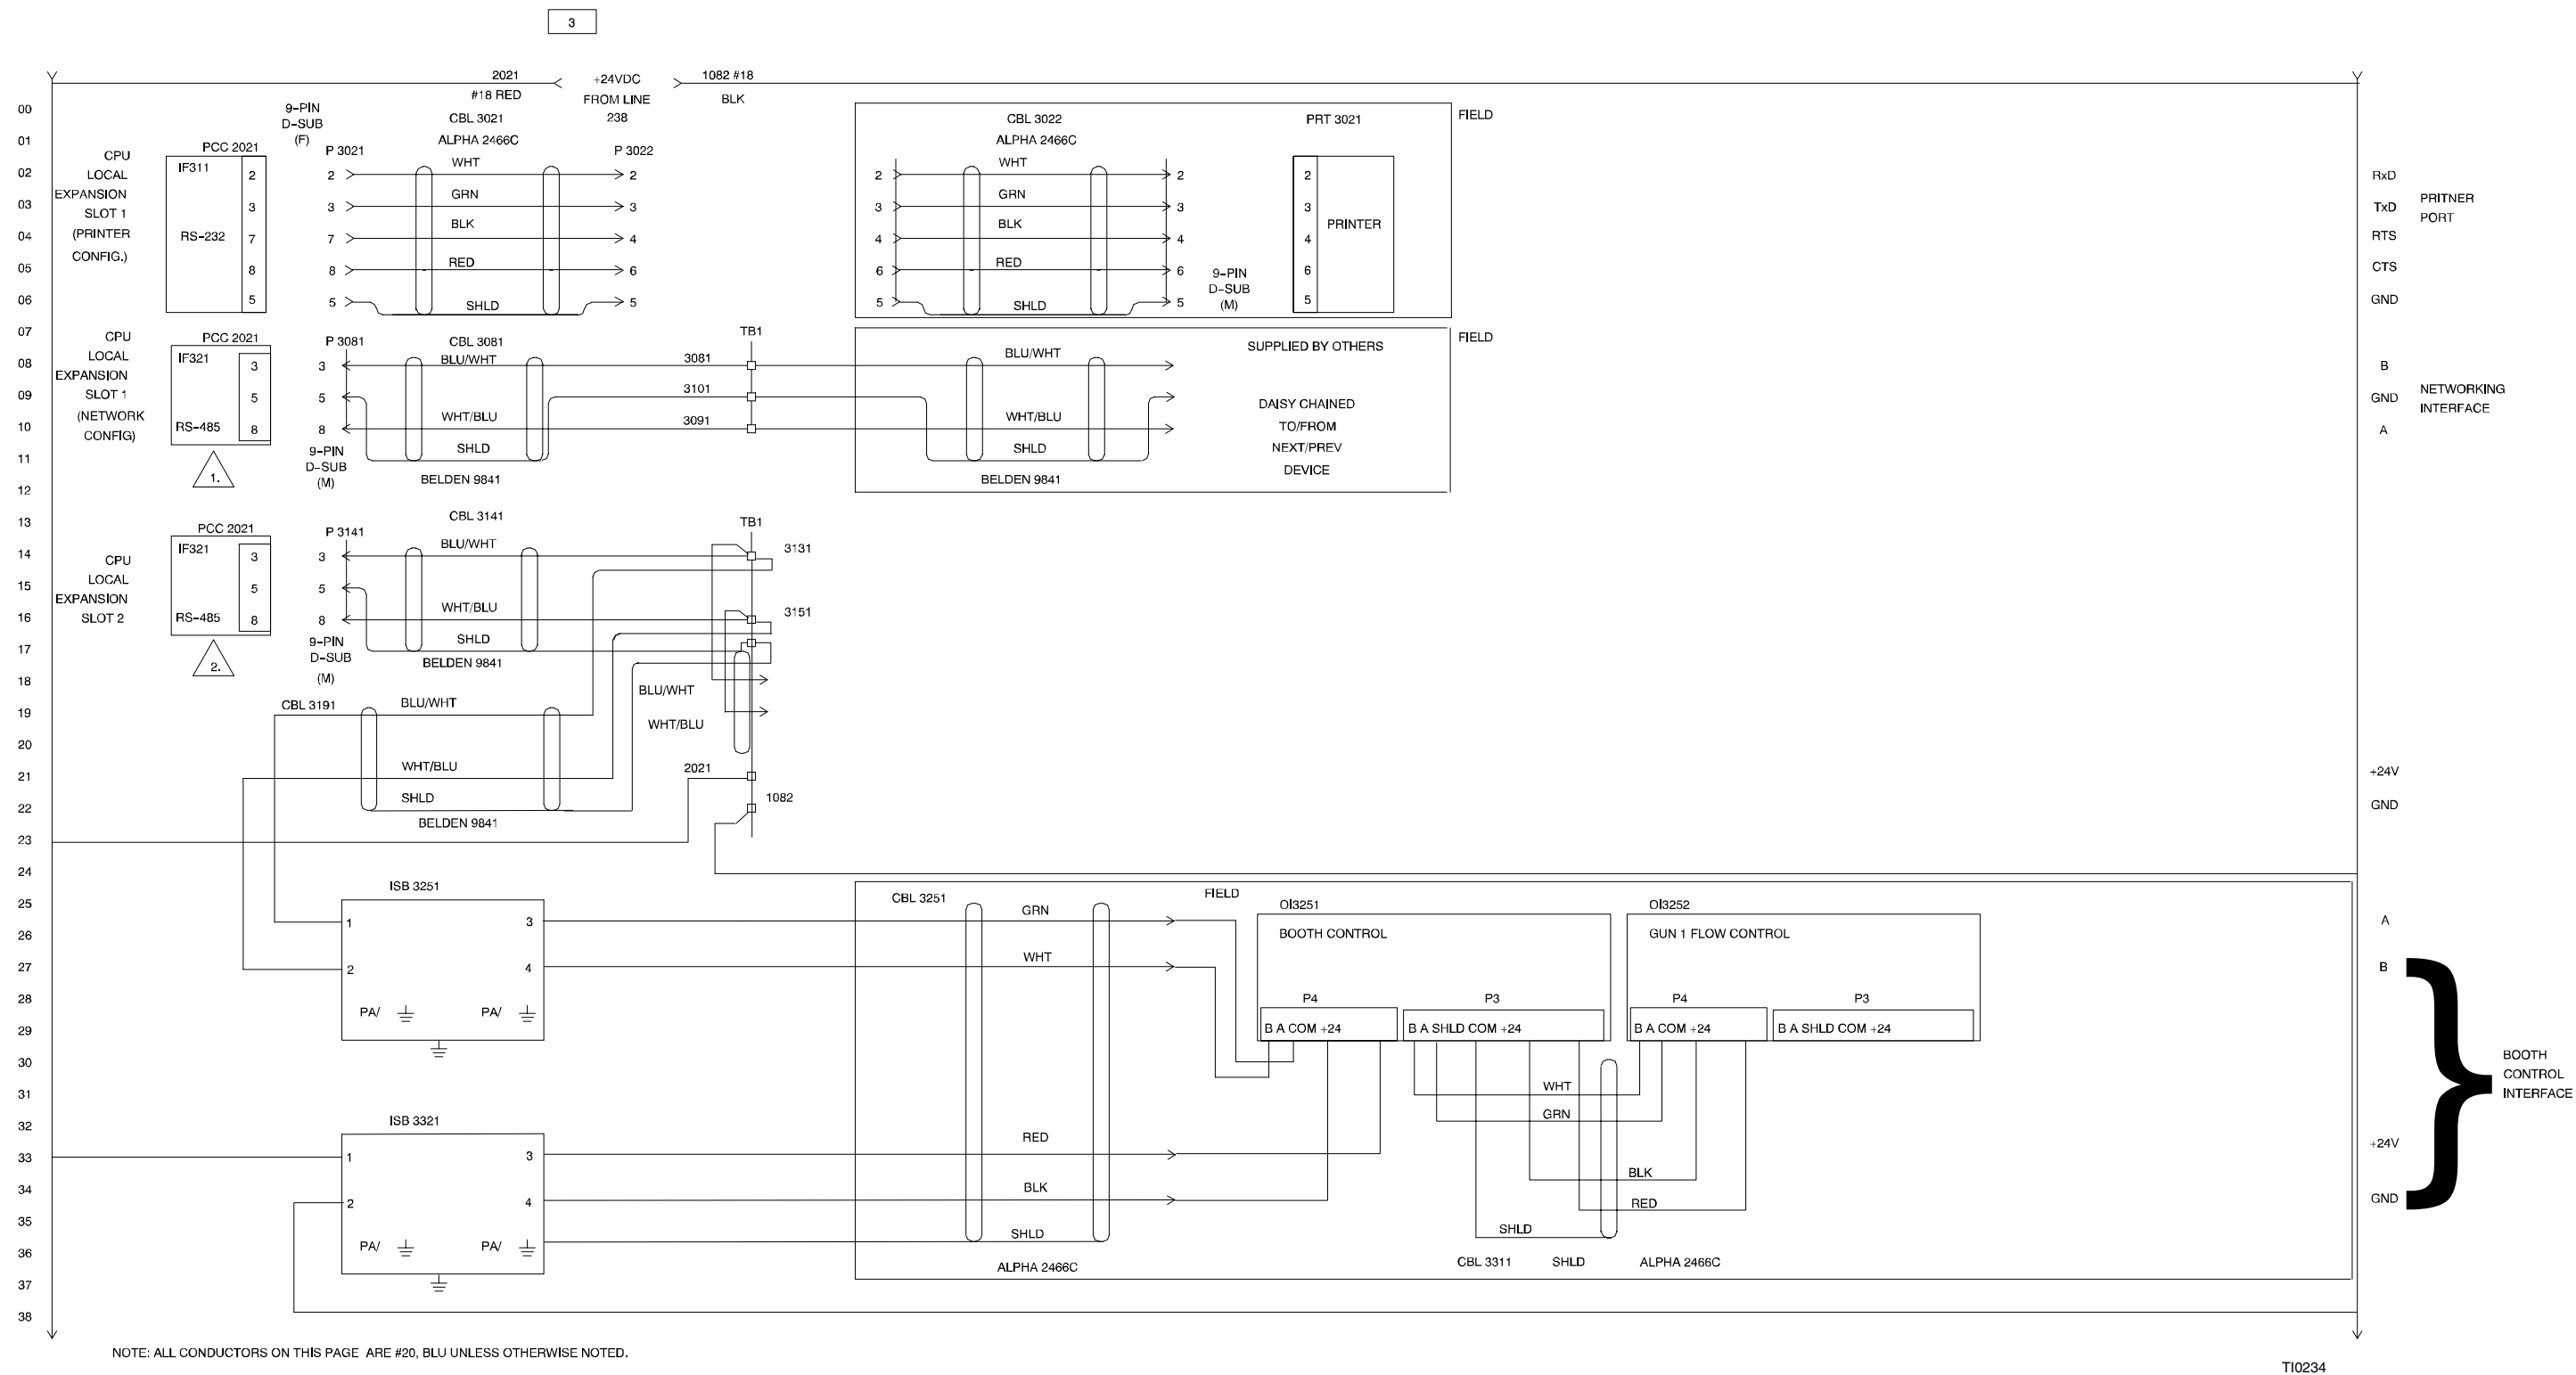


NOTE: ALL CONDUCTORS ON THIS PAGE ARE #20, BLU UNLESS OTHERWISE NOTED.

1. THE IF321 MODULE HAS A BUS TERMINATION RESISTANCE WHICH CAN BE TURNED ON OR OFF WITH A SWITCH. IF THIS MODULE IS AT EITHER END OF THE NETWORK, THE SWITCH SHOULD BE TURNED ON.


2. THE BUS TERMINATION RESISTANCE SWITCH SHOULD BE TURNED OFF.

Electrical Schematic 3

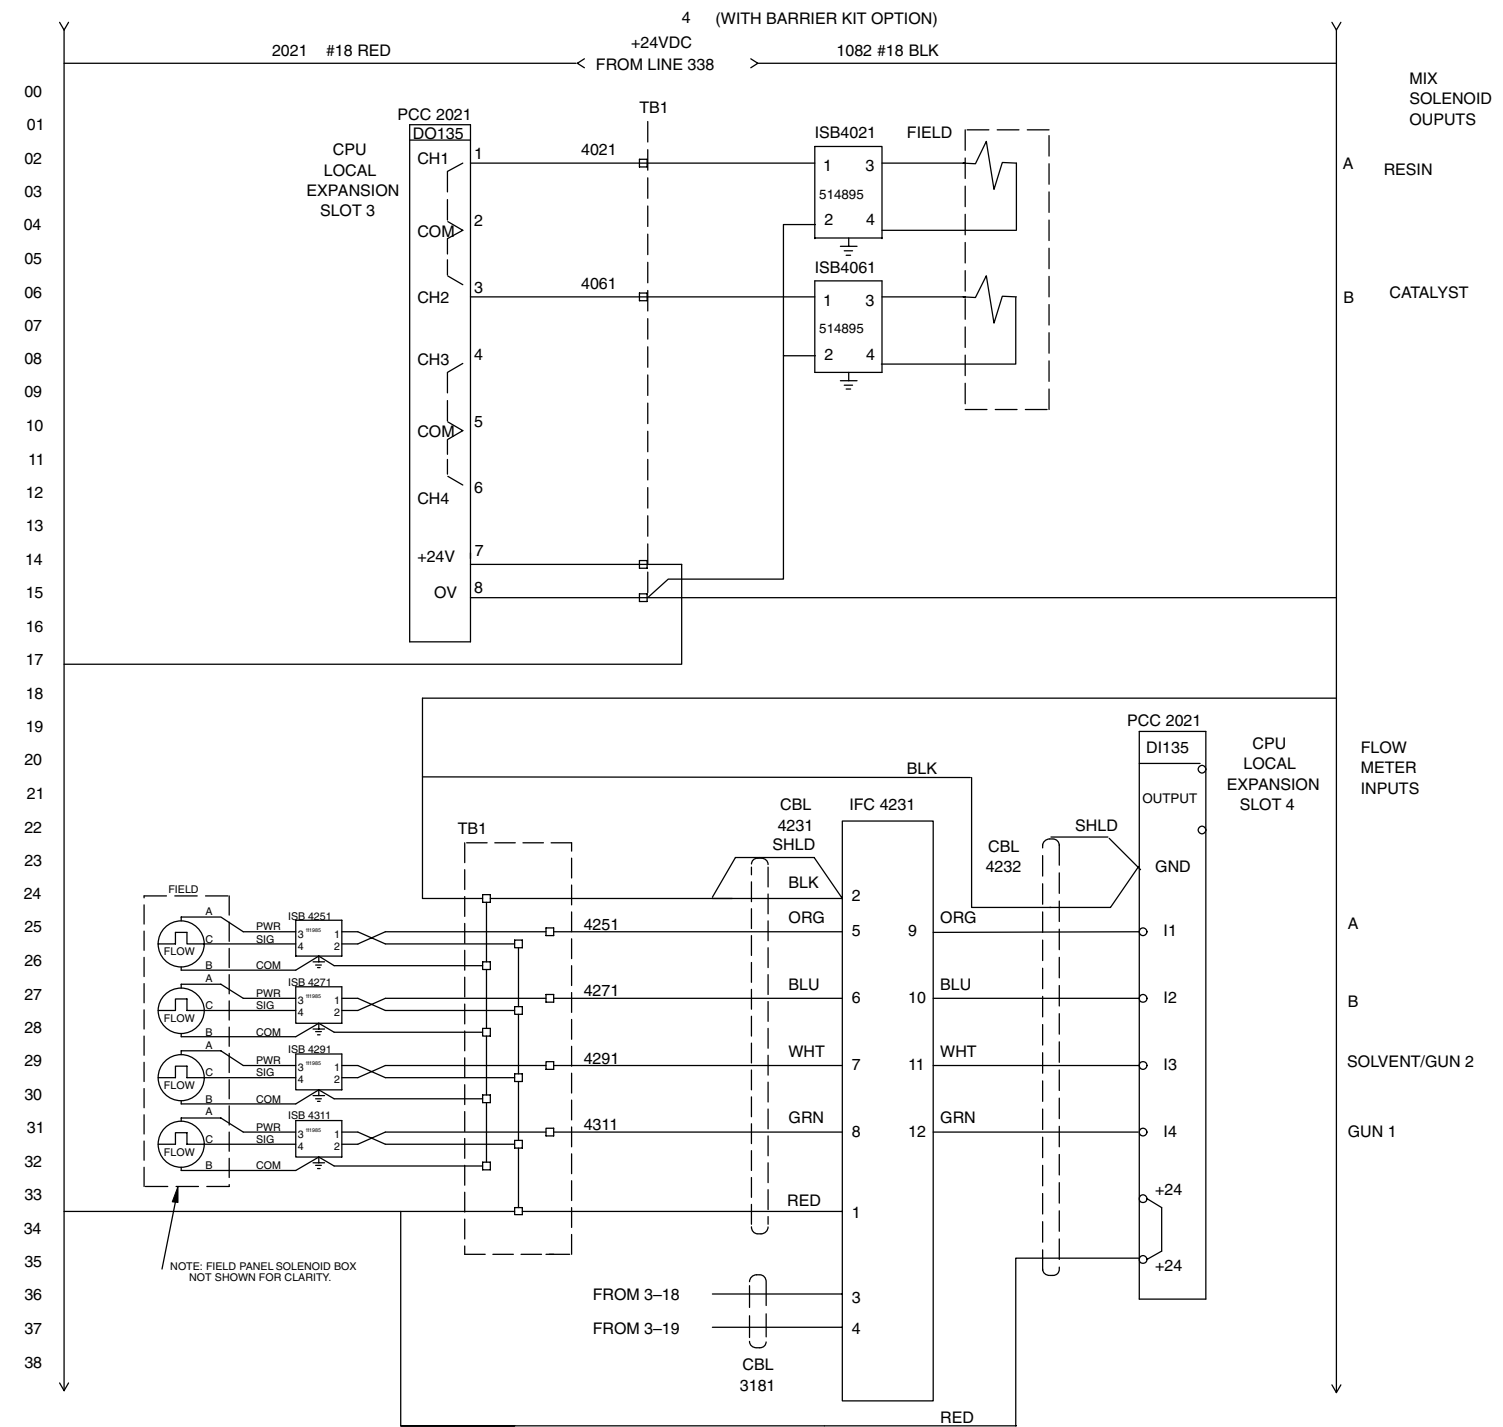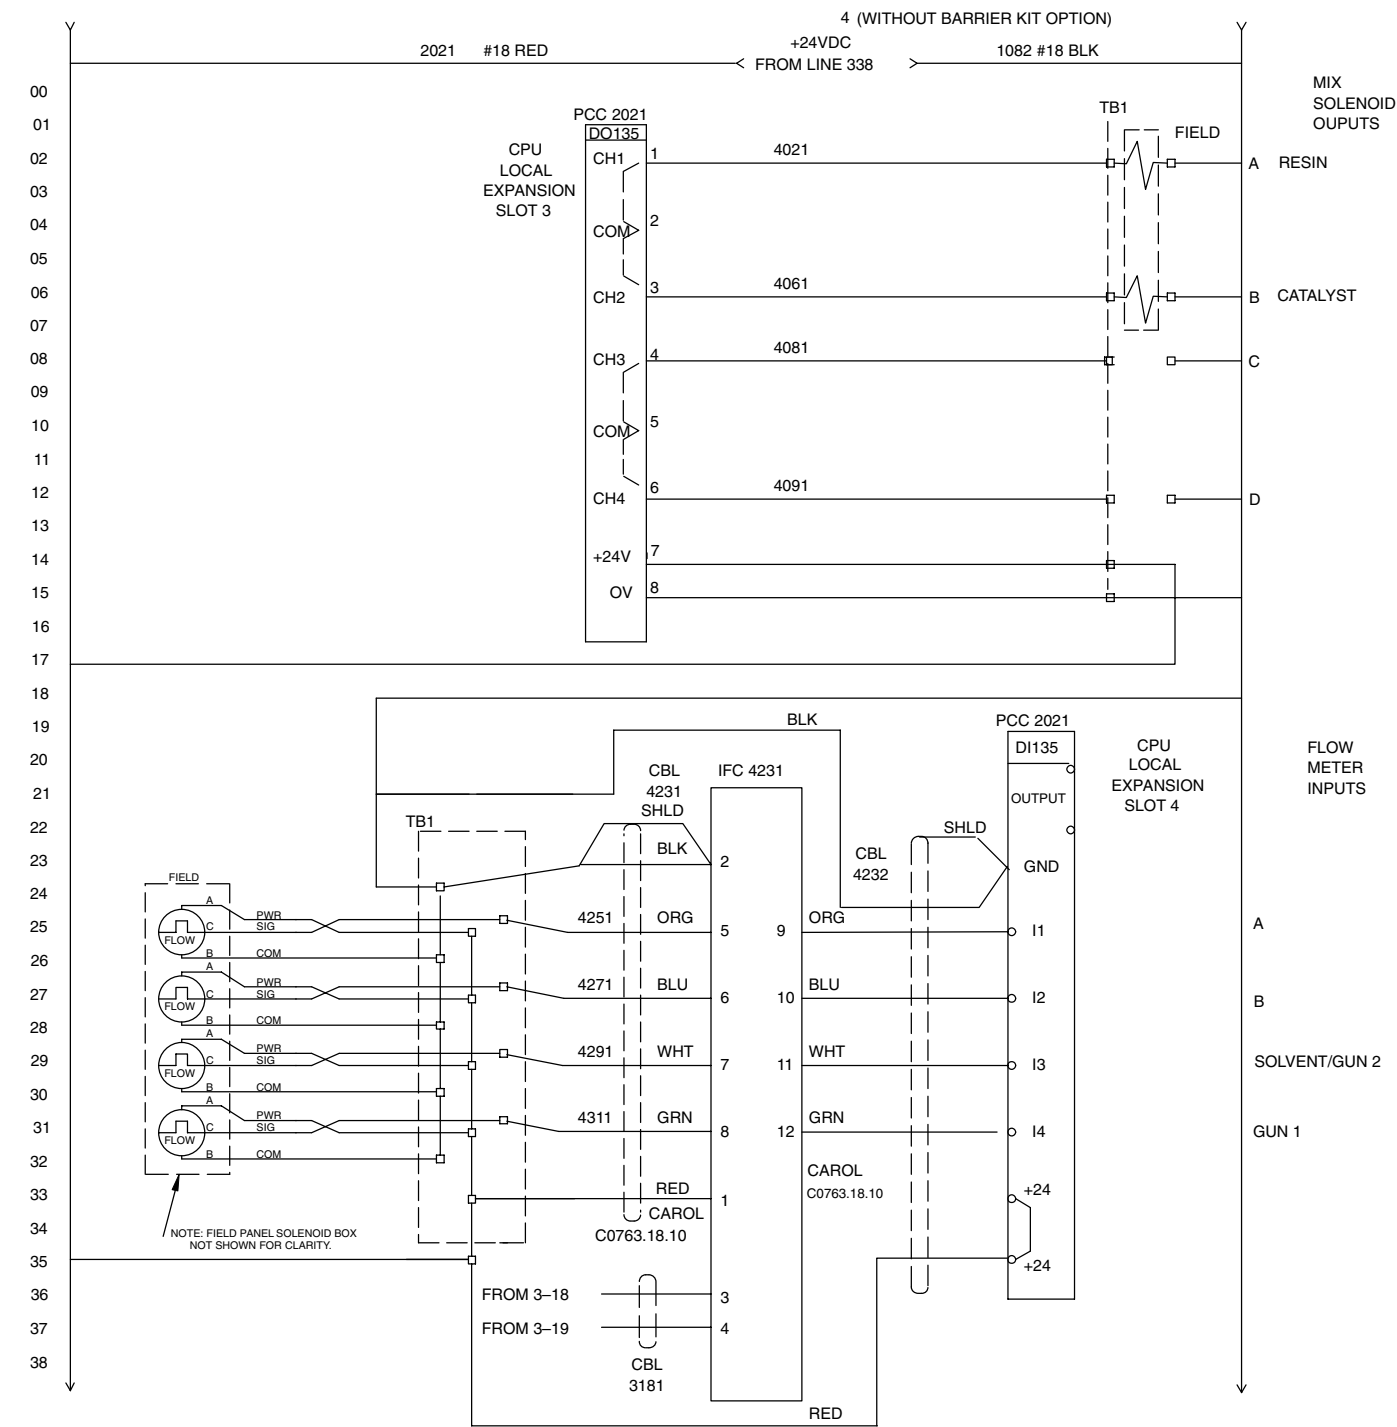


TI1707A

Electrical Schematic 4

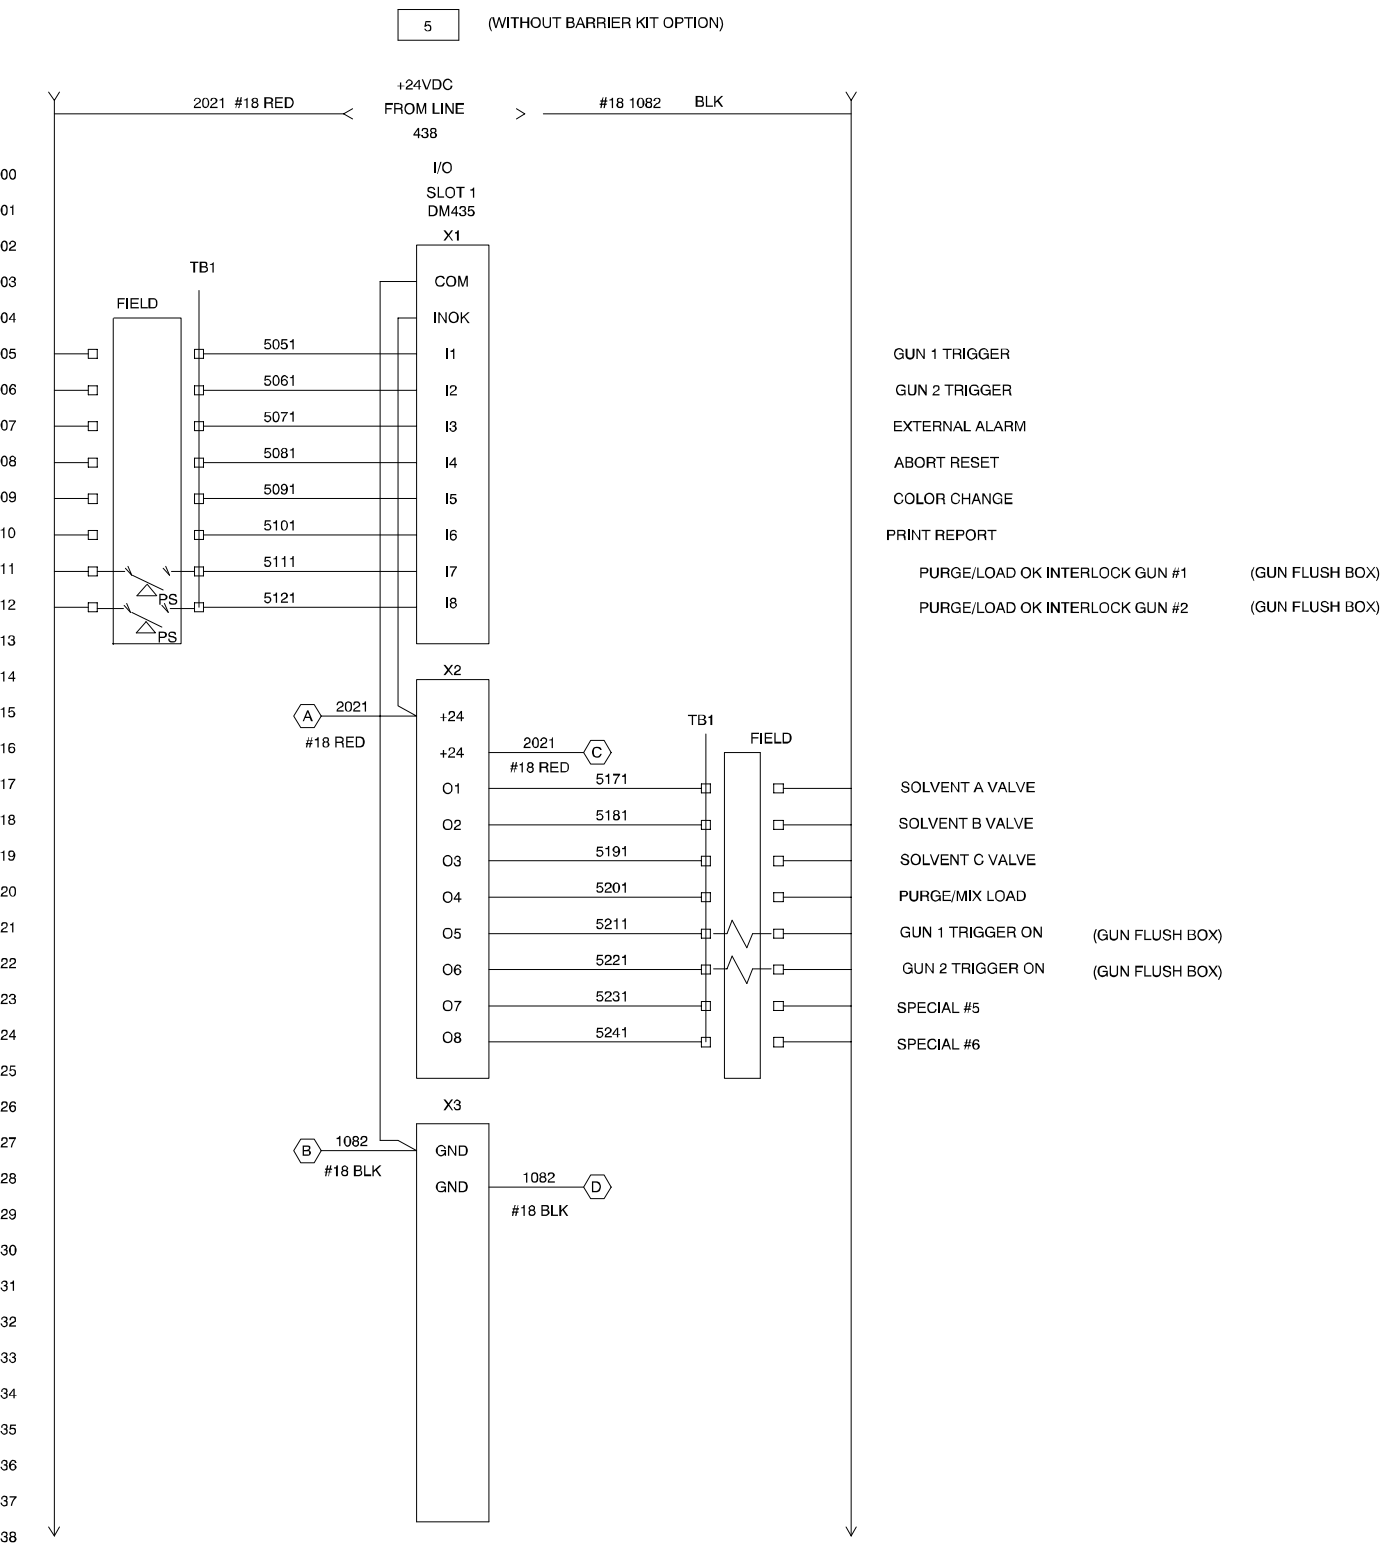


NOTE: ALL CONDUCTORS ON THIS PAGE ARE #20, BLU UNLESS OTHERWISE NOTED.


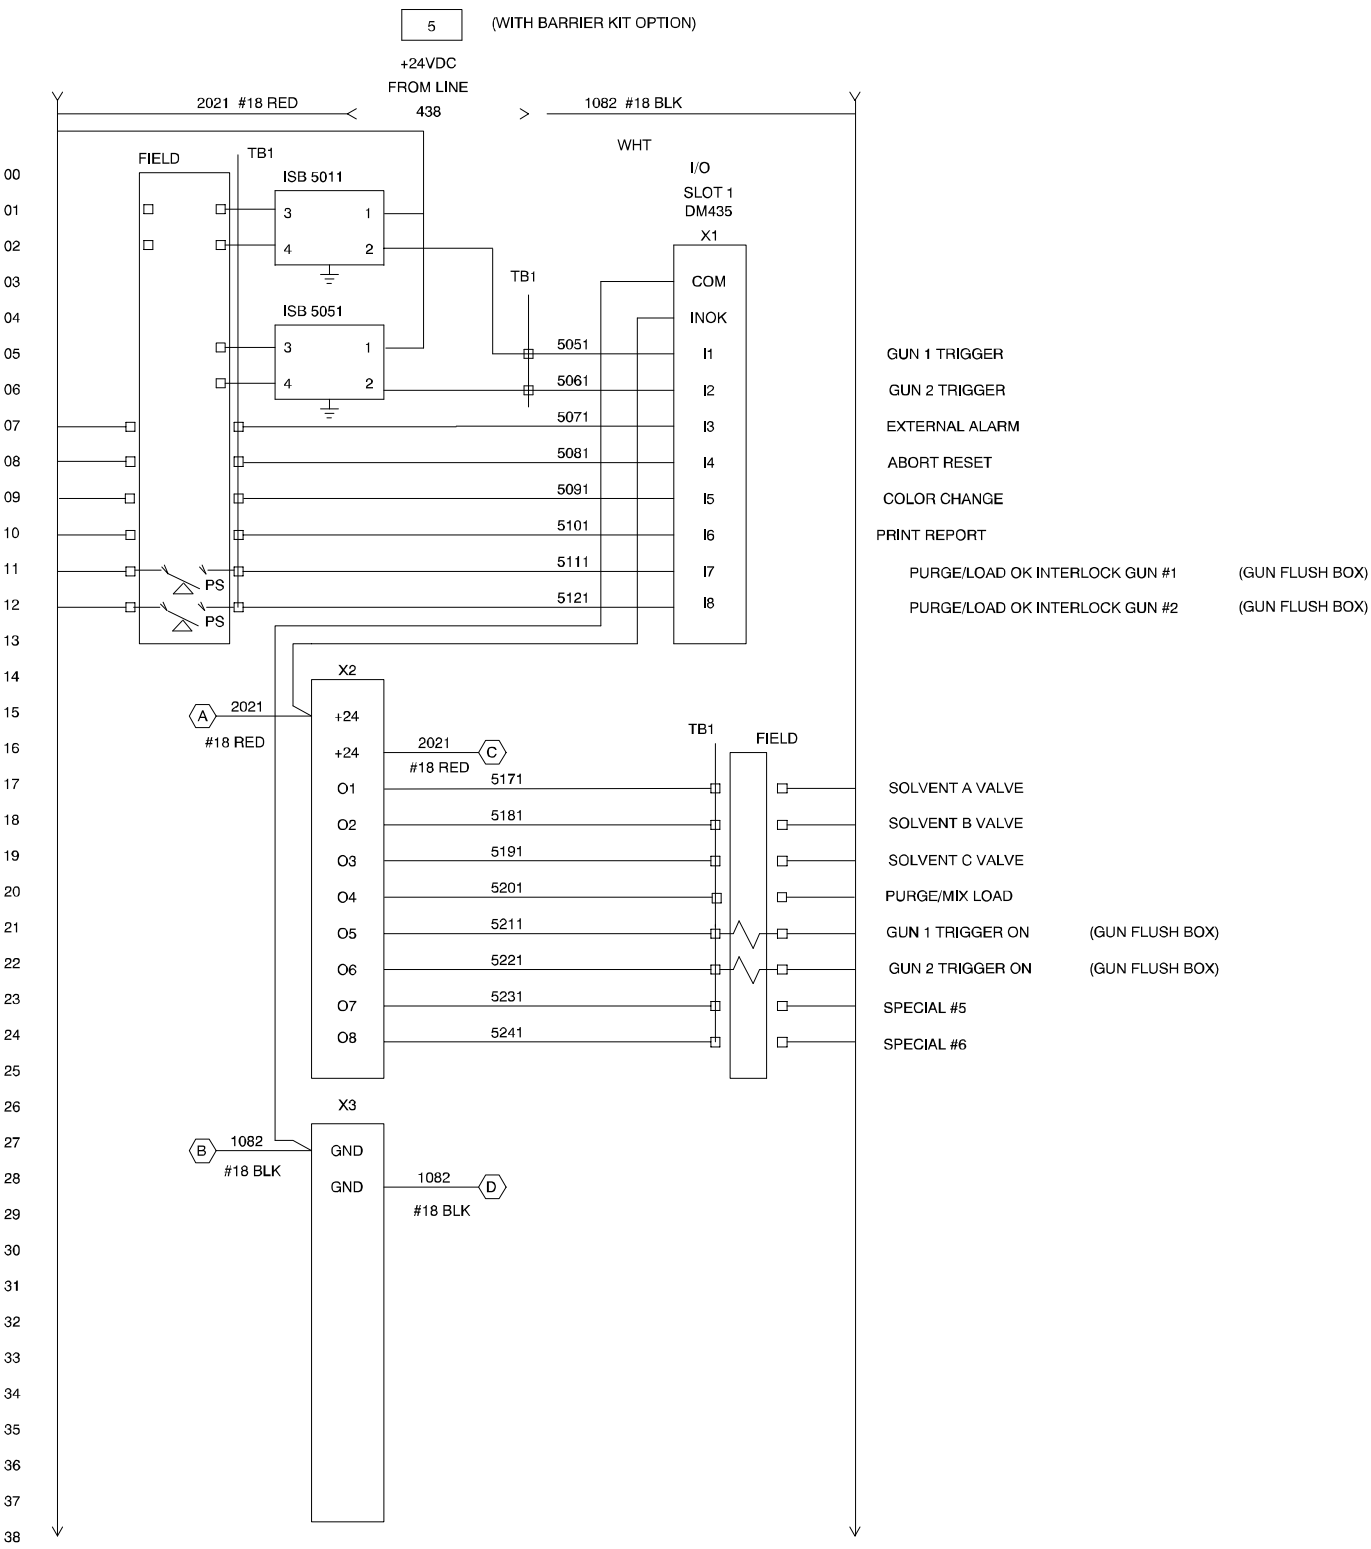


TI0236

Electrical Schematic 5

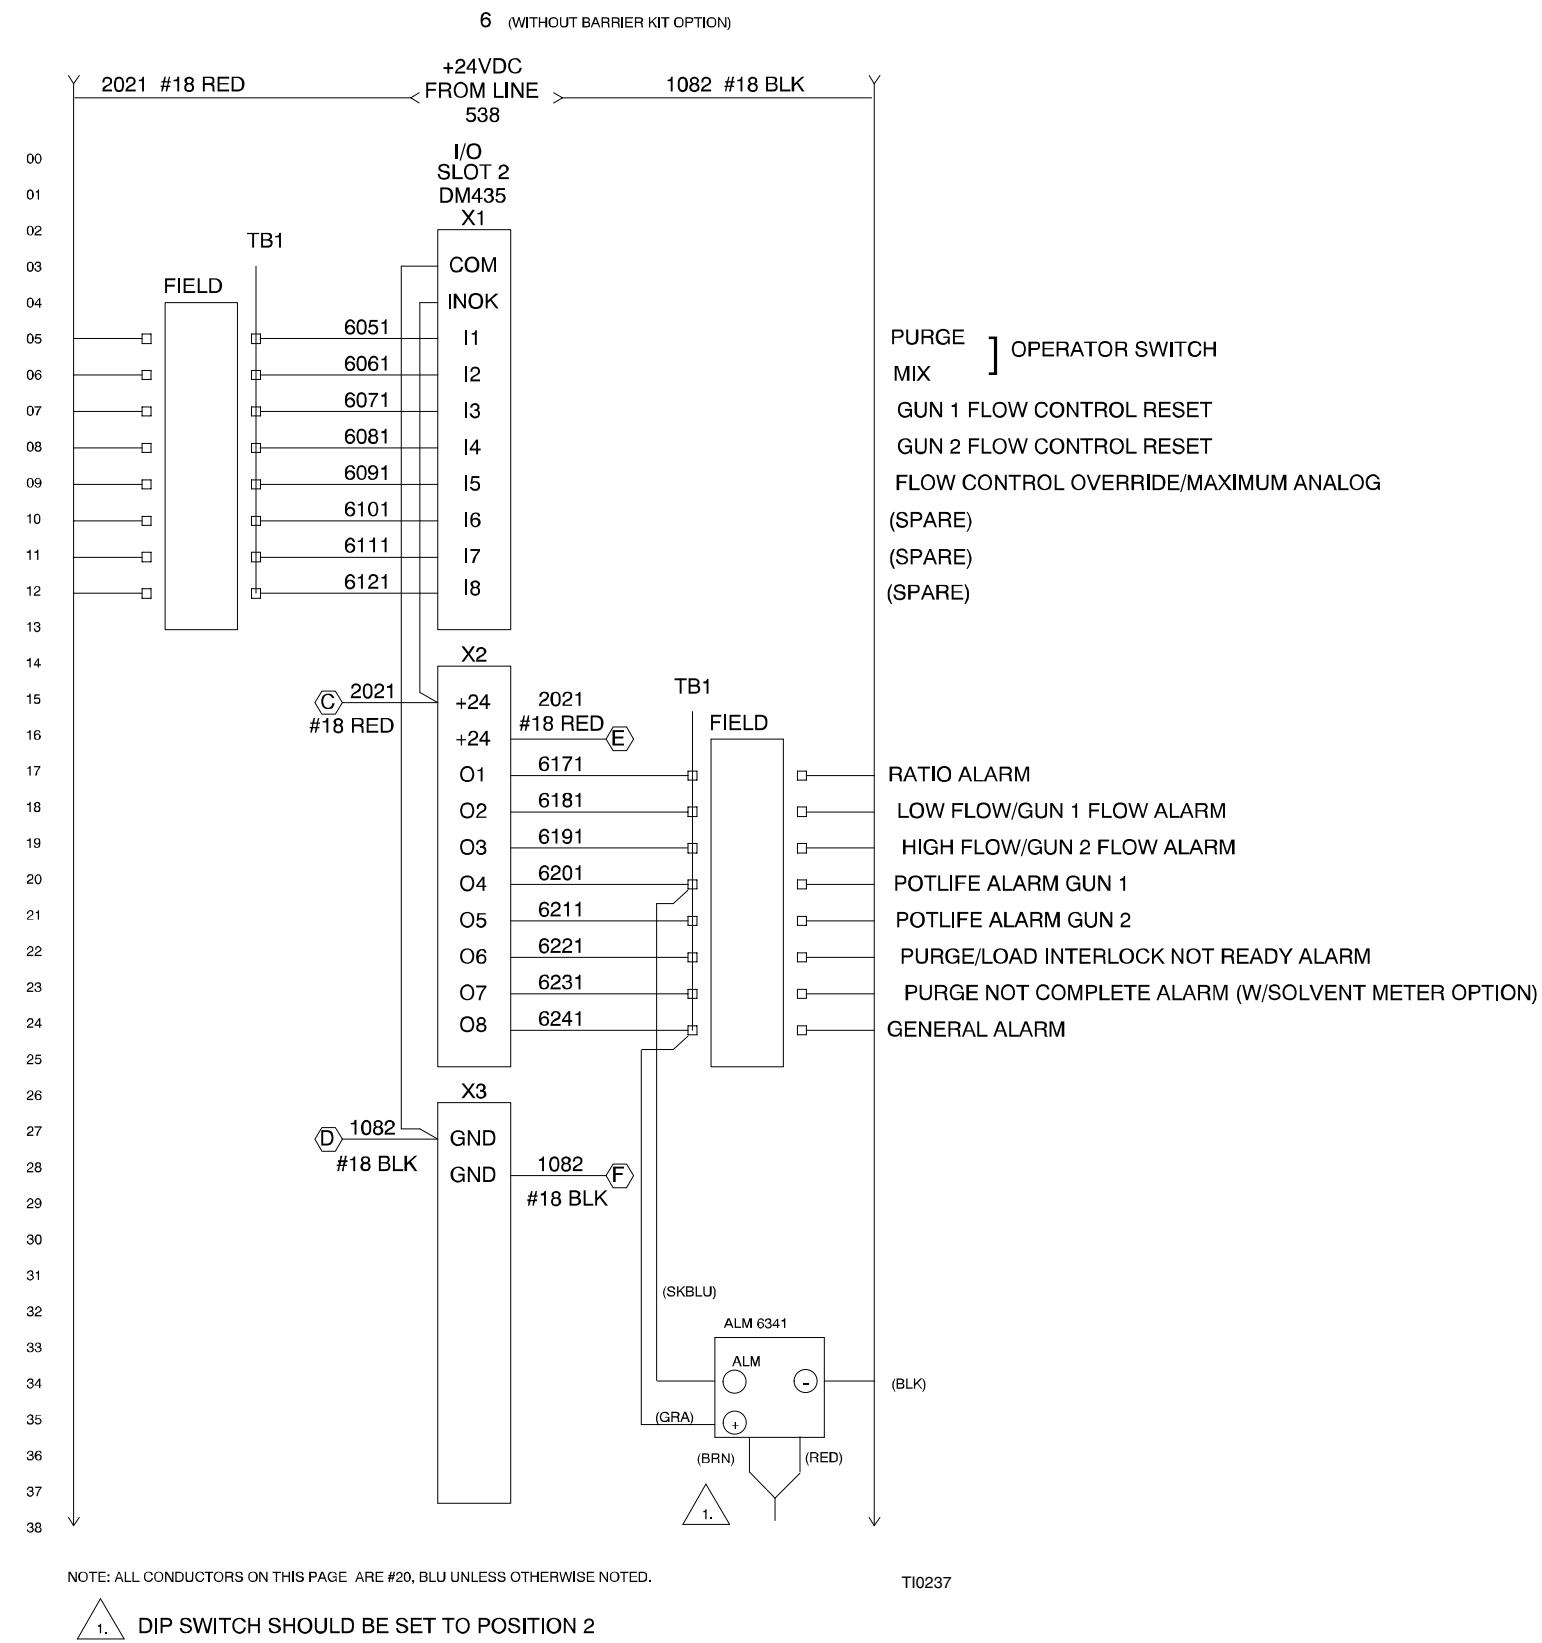

Electrical Schematic 6

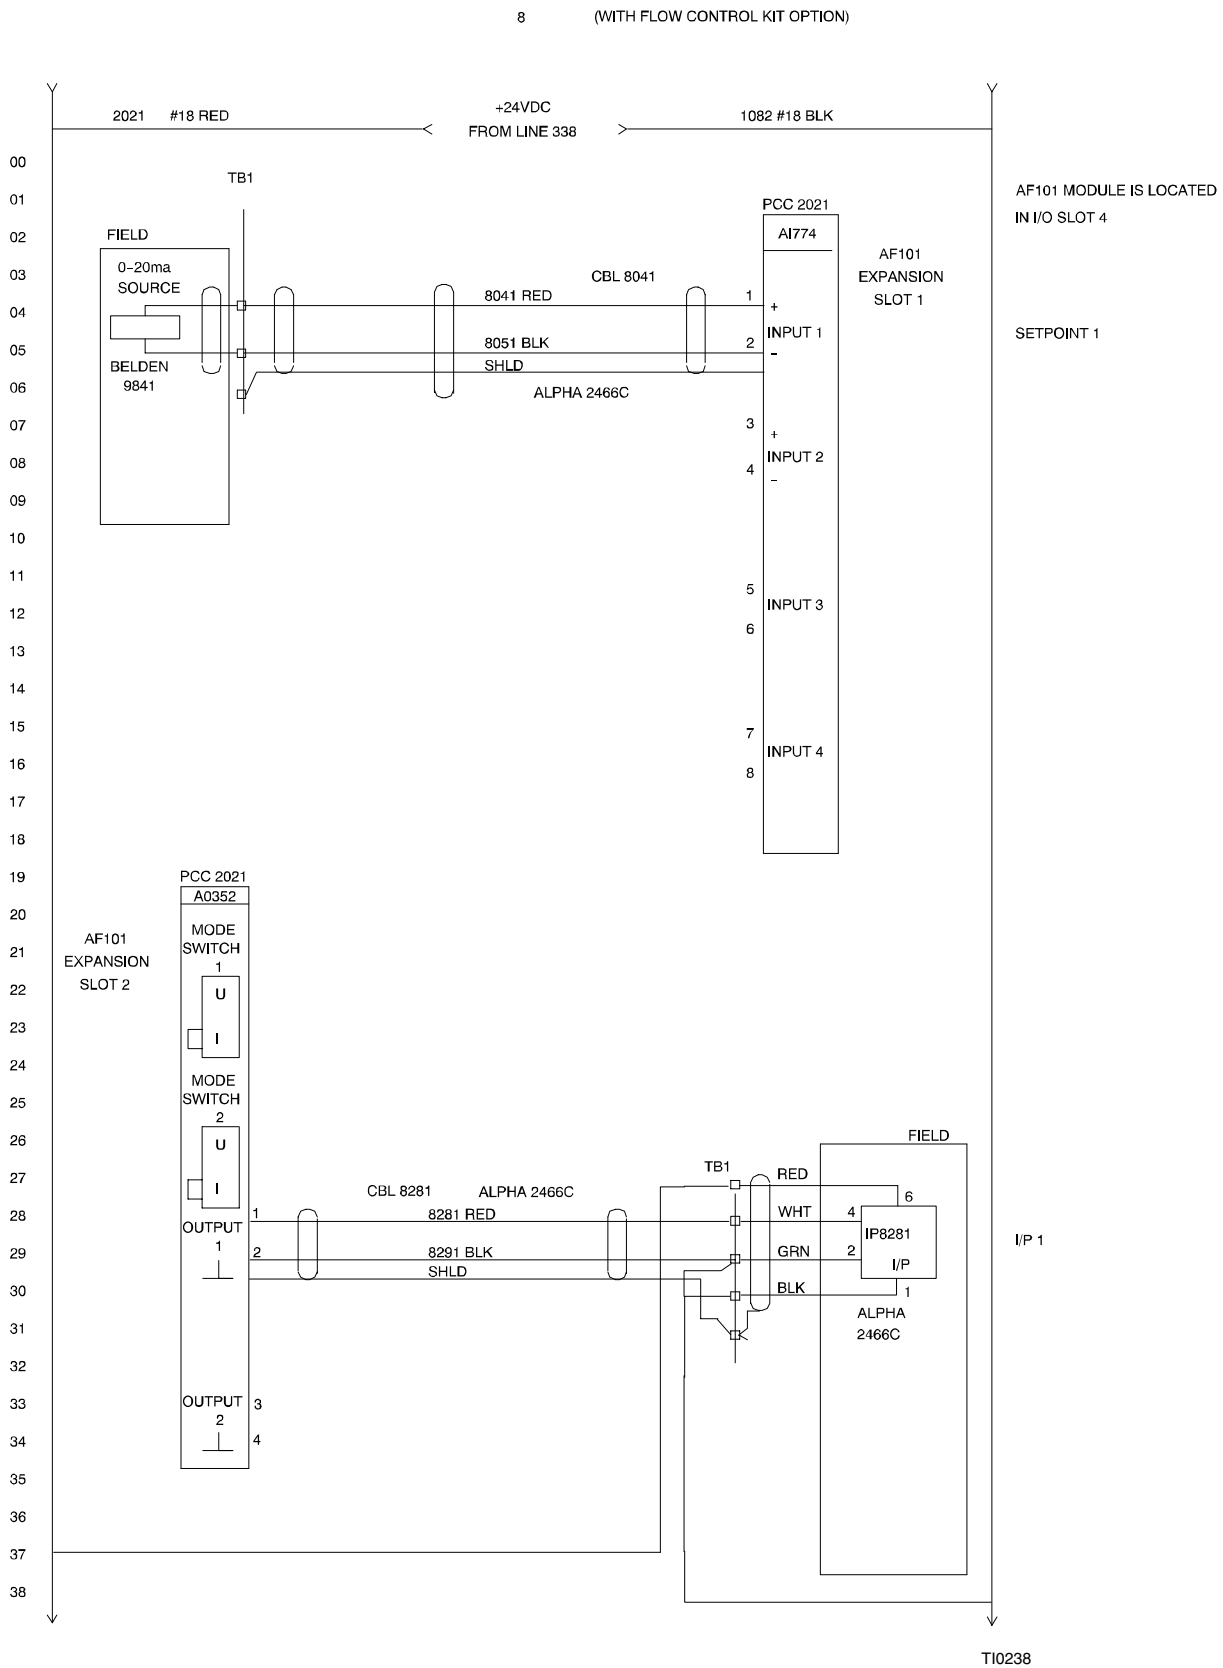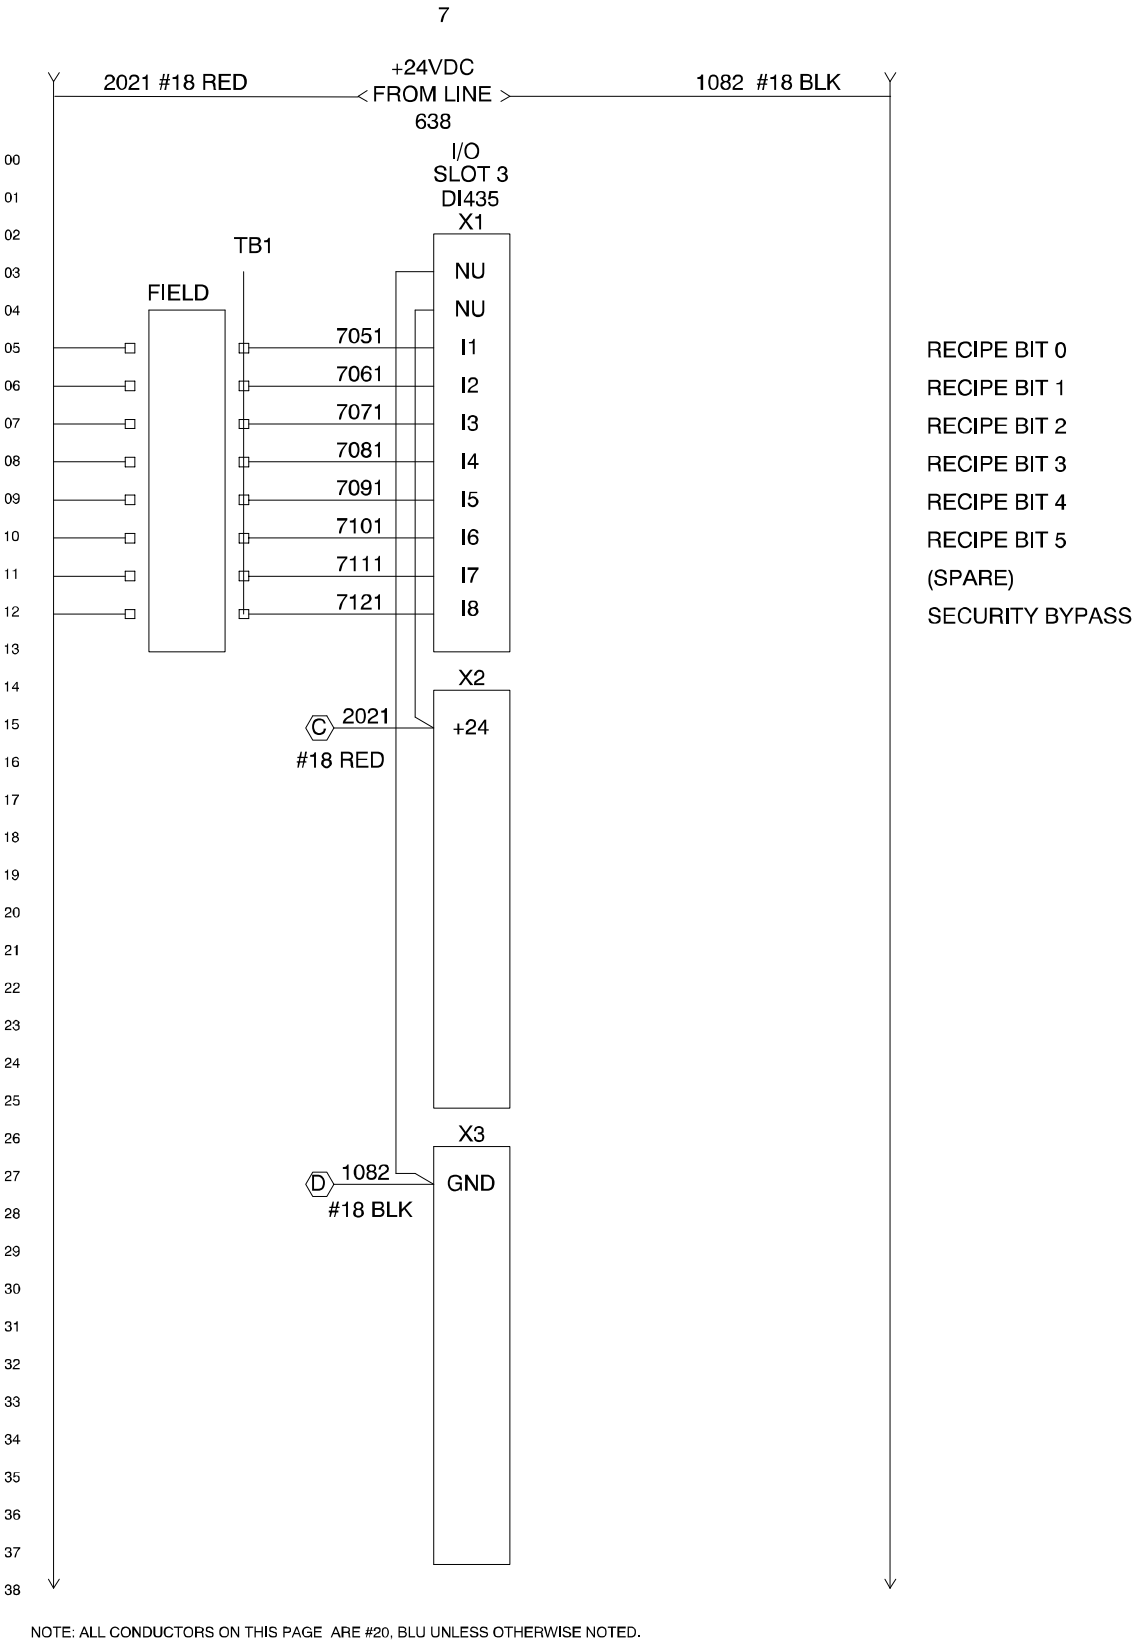

TO PLACE AN ORDER, contact your Graco distributor, or call **1-800-367-4023 Toll Free** to identify the distributor closest to you.

*All written and visual data contained in this document reflects the latest product information available at the time of publication.
Graco reserves the right to make changes at any time without notice.*

Sales Offices: Minneapolis, Detroit

Foreign Offices: Belgium, Korea, Hong Kong, Japan

GRACO INC. P.O. BOX 1441 MINNEAPOLIS, MN 55440-1441

www.graco.com

PRINTED IN U.S.A. 309138 March 2000, Revised November 2001